

**ADDENDUM NUMBER 2**  
**DATED AUGUST 7, 2020**  
**TO**  
**SPECIFICATIONS TO REQUEST FOR BIDS #21004**  
**FOR**  
**AVR SHOWROOM EQUIPMENT**



The above entitled specifications are hereby modified as follows and except as set forth herein otherwise remain unchanged and in full force and effect.

**Questions and Answers**

1. **Question:** When would the University be making the award?  
**Answer:** The goal would be to announce an award within two weeks of the return date
2. **Question:** When would the desired installation timeframe be?  
**Answer:** This is a priority for the department and the specifics would be discussed with the awarded respondent
3. **Question:** Are you open to bidding on partial or is the University looking to work with one vendor for all of the bid?  
**Answer:** The University will award on a line-by-line, based on submissions received
4. **Question:** Item 1: Please provide any relevant architectural drawings, details, or images of the subject space. The physical constraints presented by the installation location have a significant effect on the design approach and overall cost.  
**Answer:** Attached
5. **Question:** Item 1: The specified screen size is 25'x8'. Our engineering team assumes that this is referring to width and height of the desired display area. Do you have a specific target curvature radius for the display as well?  
**Answer:** Estimated screen size would be 8.5m x 2.7m. It is recommended that suppliers include specifics regarding the proposed equipment. Screen size and screen FOV/curvature, depending on screen size, will optimize VR immersive experience with viewing/seating arrangement and space constraints shown on the architectural diagram
6. **Question:** Item 1: Because no details have been provided about the subject space or existing infrastructure, our team assumes that the display is to be designed and fabricated as a freestanding structure (not hung from any existing wall or structure). Please let us know if this is the correct assumption.  
**Answer:** The concave would most likely be free-standing and not hung
7. **Question:** Item 5: Please clarify the specific manufacturer and product being requested for item #5. There are several products that have shared that name in recent years. Please also elaborate on the end-use functionality of this item.  
**Answer:** The only product we have seen is ibench from EON. However, we are interested in evaluating other products that meet the overall need
8. **Question:** Are you expecting bidders to respond to the entire bid or can responders respond to individual components?  
**Answer:** See response to Item 3
9. **Question:** What is the expected award date for the successful bidder(s)?  
**Answer:** See response to Item 1




MISSOURI

10. **Question:** Are bid responses required in hard copy format?  
**Answer:** Bid responses need submitted as a physical copy to the address provided in the RFB. For the submission, there should be a single hardcopy and an electronic PDF version for each volume
11. **Question:** We saw the minimum 2-year warranty and support req, are there any other details around service that we might need to know?  
**Answer:** There are no other requirements. The respondents should provide specifics regarding the years of warranty/support and what is included with the proposed services
12. **Question:** Are you expecting a bid directly from the vendor or would you prefer a bid from a consolidator providing all components for the bid  
**Answer:** We do not have a preference regarding the supplier. We are seeking a supplier who can provide the products and meet the requirements as specified in the RFB
13. **Question:** If you are expecting a bid from the vendor, would you accept a partial bid just for one item?  
**Answer:** See response to Item 3
14. **Question:** Will you accept a response from a non-US company or would you prefer we bid through a US-based organization.  
**Answer:** Non-US suppliers can respond to the RFB
15. **Question:** The bid mentions Volume 1 and Volume 2. Do you require a Volume 1 or are you just expecting the Bid Form Pricing section? is there a Word template we can complete for these?  
**Answer:** The submission should include two separate files. The fiscal piece (Volume 2) must be submitted and sealed. Volume 2 must be separate from the response document (volume 1)
16. **Question:** Will you accept electronic (emailed) bids?  
**Answer:** No. Bids must be submitted to the physical address outlined in the RFB
17. **Question:** I assume you can receive FedEx delivery at the address provided?  
**Answer:** Yes. As a reminder, Amendment 1 changed the due date to August 13 at 2:00 PM  
Attention: Melissa Wampler  
University of Missouri System Procurement  
2910 LeMone Industrial Blvd  
Columbia, Missouri 65201
18. **Question:** Is there a form / format for Volume I (Functional Section)?  
**Answer:** There isn't a specific format, however to limit the evaluation time it is preferred to address the Detailed Specifications sections as outlined in the RFB

THE CURATORS OF THE UNIVERSITY OF MISSOURI


*Melissa Wampler*

By: Melissa Wampler, MS, PMI-PBA  
Strategic Sourcing Specialist  
University of Missouri System Procurement

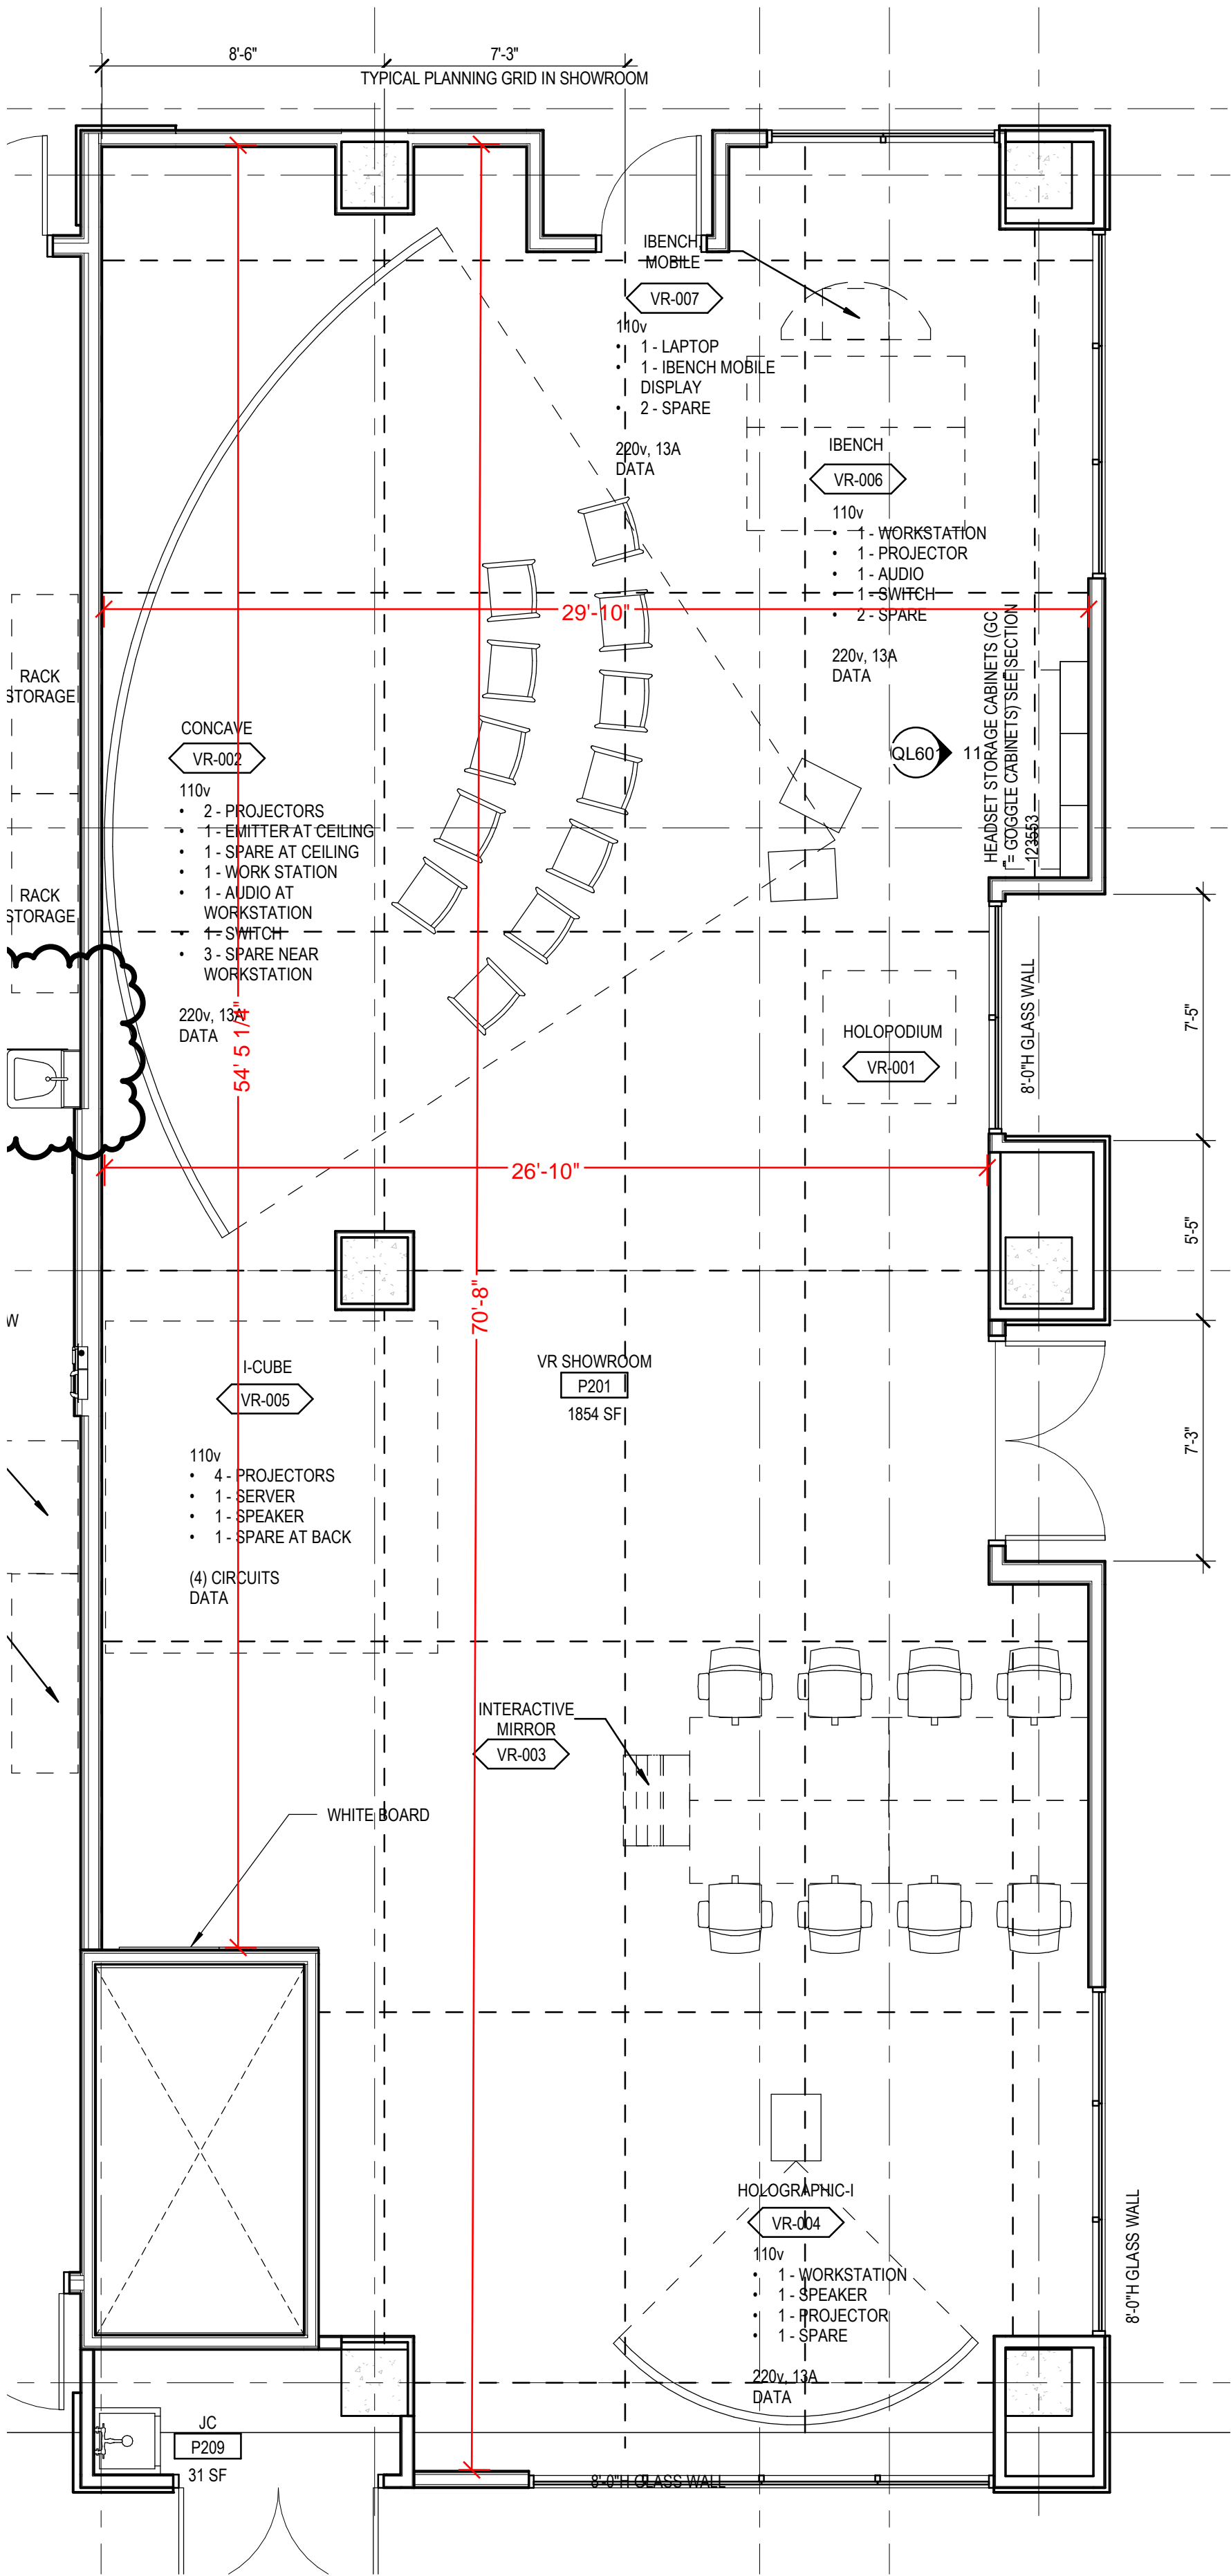

FLOOR PLAN

SCALE: 1/4" = 1'-0"

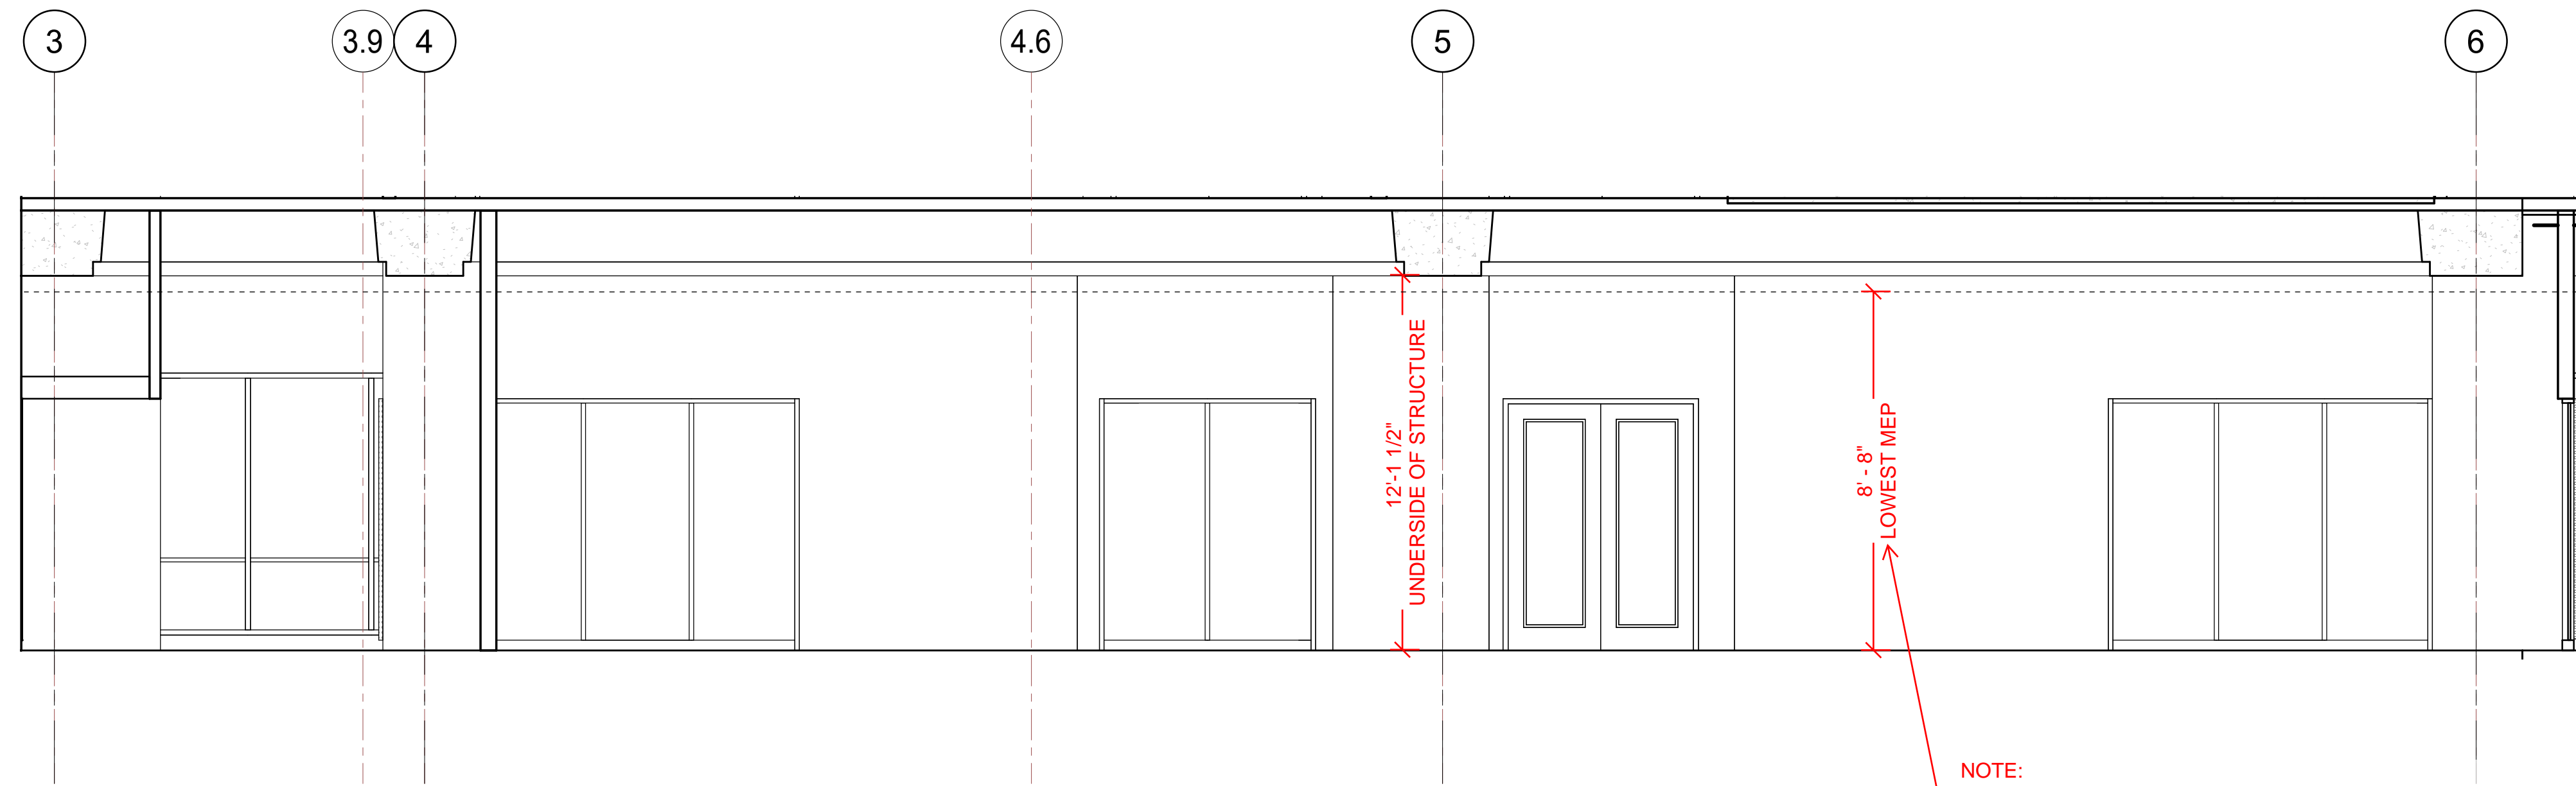

SECTION LOOKING EAST

SCALE: 1/4" = 1'-0"