


**NOTES:**

1. OWNER WILL FURNISH THE DISCONNECT SWITCHES (2), STARTERS (2), HOUR METERS (2) AND CONTROLS, MOUNTED ON A 3'-0" X 3'-0" X 3/4" PLYWOOD.
2. CONTRACTOR SHALL INSTALL THE PANEL NEAR THE SUMP PUMPS, ON METAL FRAMING OR ADJACENT WALLS, PROVIDE THE POWER SPECIFIED AS REQUIRED FOR EACH PUMP AND 120V DEDICATED POWER TO THE CONTROLS.
3. CONTRACTOR SHALL PROVIDE THE BALL FLOATS, RODS, SWITCHES AND MOUNTING BRACKETS AS SHOWN. PROVIDE WIRING BETWEEN THE FLOAT SWITCHES AND THE CONTROLLER AND TERMINATE IN THE CONTROL PANEL.
4. CONTRACTOR SHALL INSTALL POWER FROM THE STARTERS TO EACH PUMP IN FLEXIBLE WEATHER TIGHT CONDUIT.

1 CONTROL PANEL (MU only)  
1 SCALE: NTS

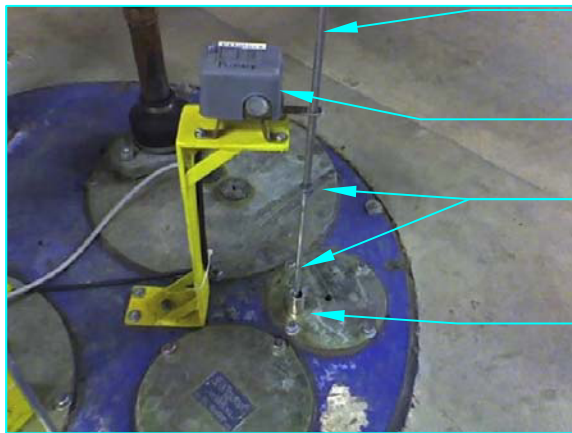

- 3/8"  $\phi$  ALUM THD. ROD, PROVIDE 6"  $\phi$  ST STEEL ROUND FLOAT
- FLOAT SWITCH SQD MODEL #
- SET SCREW COLLARS FOR LEVEL CONTROL
- 1/2"  $\phi$  EMT GUIDE- LENGTH VARIES AS DEPTH OF SUMP

2 FLOAT SWITCH (TYP OF 2)  
1 SCALE: NTS

DATE: 07/18/12



DWN BY: AM  
CKD BY: LS

SUMP-PUMP-ELETRICAL-DETAIL  
ELETRICAL\_PANEL



MAINTENANCE  
CAMPUS FACILITIES  
UNIVERSITY OF MISSOURI-COLUMBIA

PROJECT NUMBER

SHEET

1 of 1