NAMEPLATE SCHEDULE	
LOCATION ON PANEL	NAMEPLATE MESSAGE
①	SERVICE ENTRANCE 1 OF 2 (MAIN)
②	SERVICE ENTRANCE 2 OF 2 (CONTROL POWER)
③	CONTROL POWER DISCONNECT

NOTES

1. INSTALL ENGRAVED NAMEPLATE AS SHOWN IN SCHEDULE ONTO SERVICE ENTRANCE PANEL AT LOCATION INDICATED. NAMEPLATE TO BE 1/4" BLACK LETTERS ON WHITE BACKGROUND.

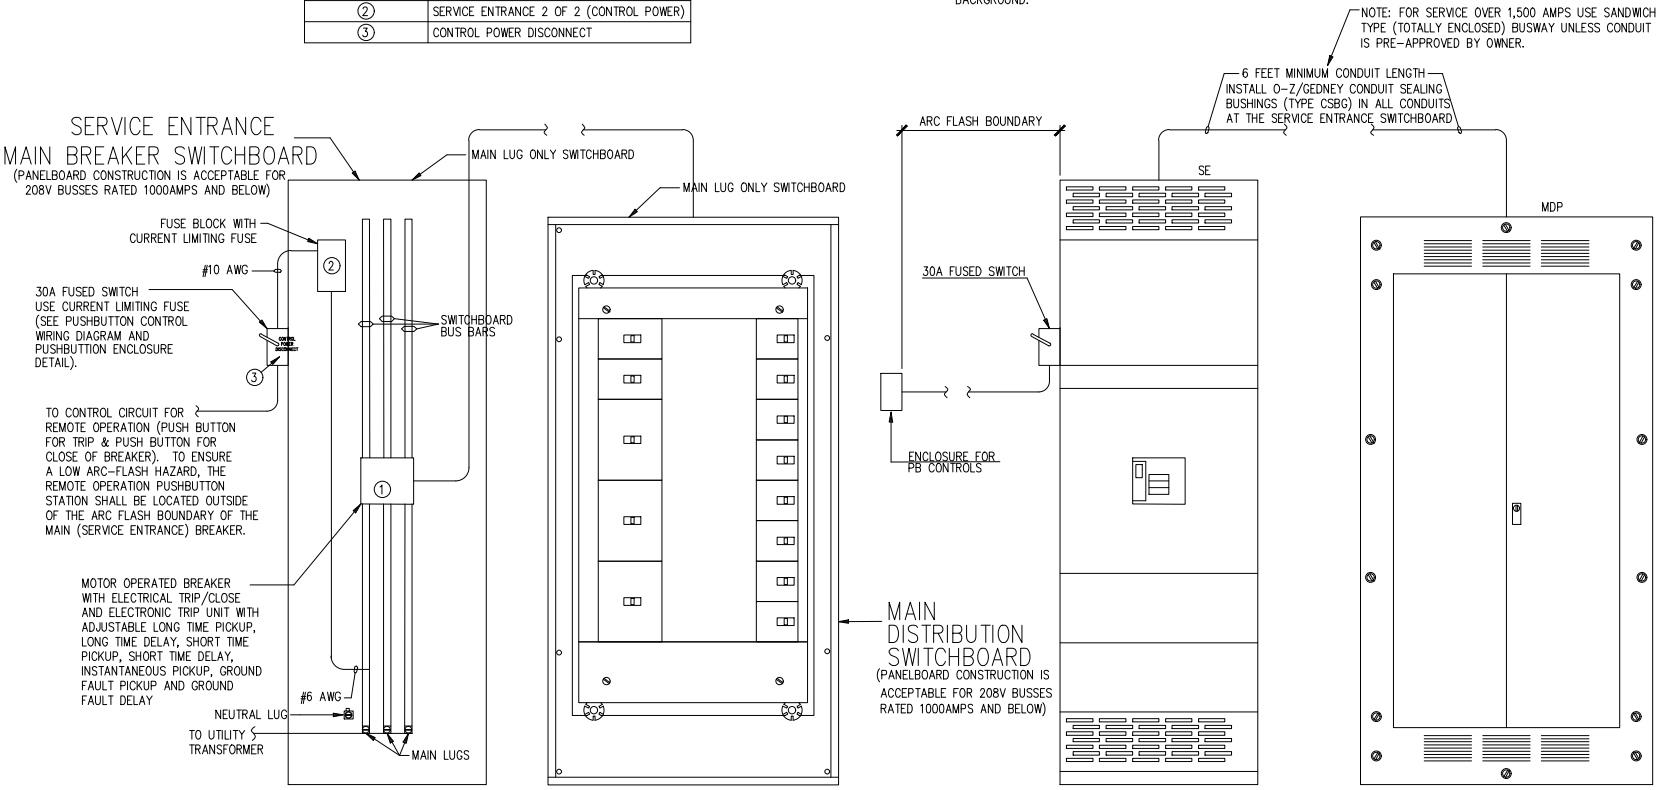

1 E1 SERVICE ENTRANCE DETAIL

SCALE NOT TO SCALE

2 E1 SERVICE ENTRANCE ELEVATION

SCALE NOT TO SCALE

05/30/18	ISSUED FOR CONSTRUCTION	
		DWN BY: JDR CKD BY:

GENERAL SITE
COLUMBIA, BOONE COUNTY, MISSOURI 65211
SERVICE ENTRANCE DETAIL

CAMPUS FACILITIES
Planning, Design & Construction
Design Services
UNIVERSITY OF MISSOURI

PROJECT NUMBER
CP_____

SHEET
E1
of 2

NOTES

1. PUSHBUTTONS SHALL HAVE PROTECTIVE SHROUDS.
2. OPEN PUSHBUTTON SHALL BE GREEN COLOR.
3. CLOSE PUSHBUTTON SHALL BE RED COLOR.
4. PROVIDE NEMA 3R ENCLOSURE WITH HINGED COVER AND PROVISIONS FOR PADLOCKING.
5. POWER TO PUSHBUTTON CIRCUIT SHALL BE DERIVED FROM SE BREAKER LINE-SIDE VOLTAGE W/ PROTECTION

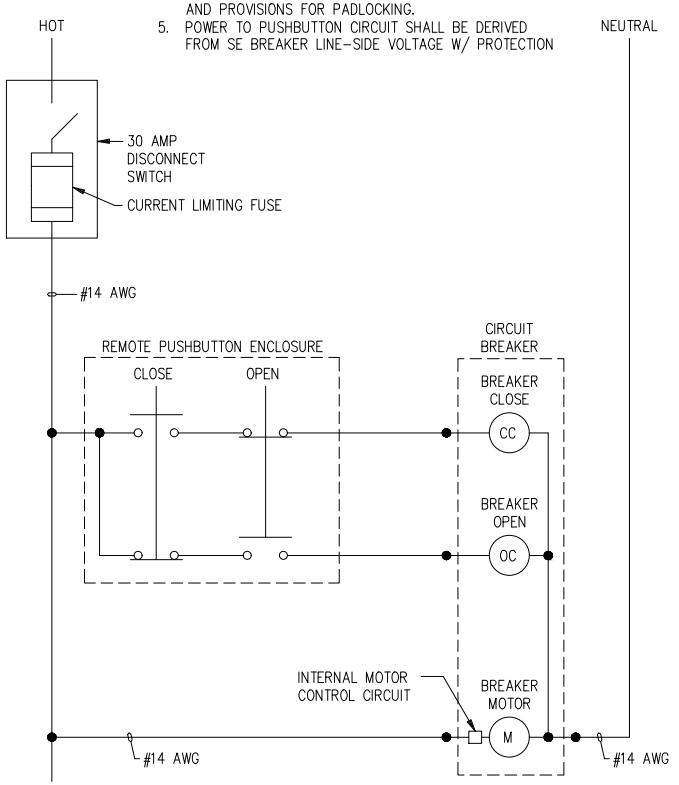

PUSHBUTTON CONTROL WIRING DIAGRAM

1 / E2

SCALE NOT TO SCALE

NOTES

1. PUSHBUTTONS TO BE HEAVY DUTY 30.5 mm MOUNTED IN DIE-CAST ZINC BOX WITH 3/4" NPT CONDUIT ENTRANCE.
2. PUSHBUTTON MODULE (SEE NOTE 1) TO BE MOUNTED IN THE BACK OF A 8" X 10" X 6" DEEP NEMA 3R ENCLOSURE.
3. INSTALL ENGRAVED NAMEPLATE AS SHOWN IN SCHEDULE FOR PUSHBUTTONS AND ON ENCLOSURE AT LOCATION INDICATED. NAMEPLATE TO BE 1/8" (MIN.) BLACK LETTERS ON WHITE BACKGROUND.

NAMEPLATE SCHEDULE	
LOCATION ON PANEL	NAMEPLATE MESSAGE
①	BUILDING MAIN CIRCUIT BREAKER REMOTE OPERATION PUSHBUTTON STATION
②	OPEN
③	CLOSE

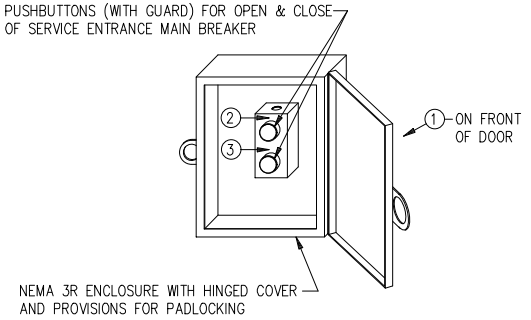

ENCLOSED PUSHBUTTON CONTROL DETAIL

2 / E2

SCALE NOT TO SCALE

05/30/18	ISSUED FOR CONSTRUCTION
DWN BY: JDR	CKD BY:

GENERAL SITE
COLUMBIA, BOONE COUNTY, MISSOURI 65211
SERVICE ENTRANCE DETAIL
PUSHBUTTON AND ENCLOSURE DETAILS

CAMPUS FACILITIES
Planning, Design & Construction
Design Services
UNIVERSITY OF MISSOURI

PROJECT NUMBER
CP_____

SHEET
E2
of 2